


No.	DATE	REVISION	CHECK

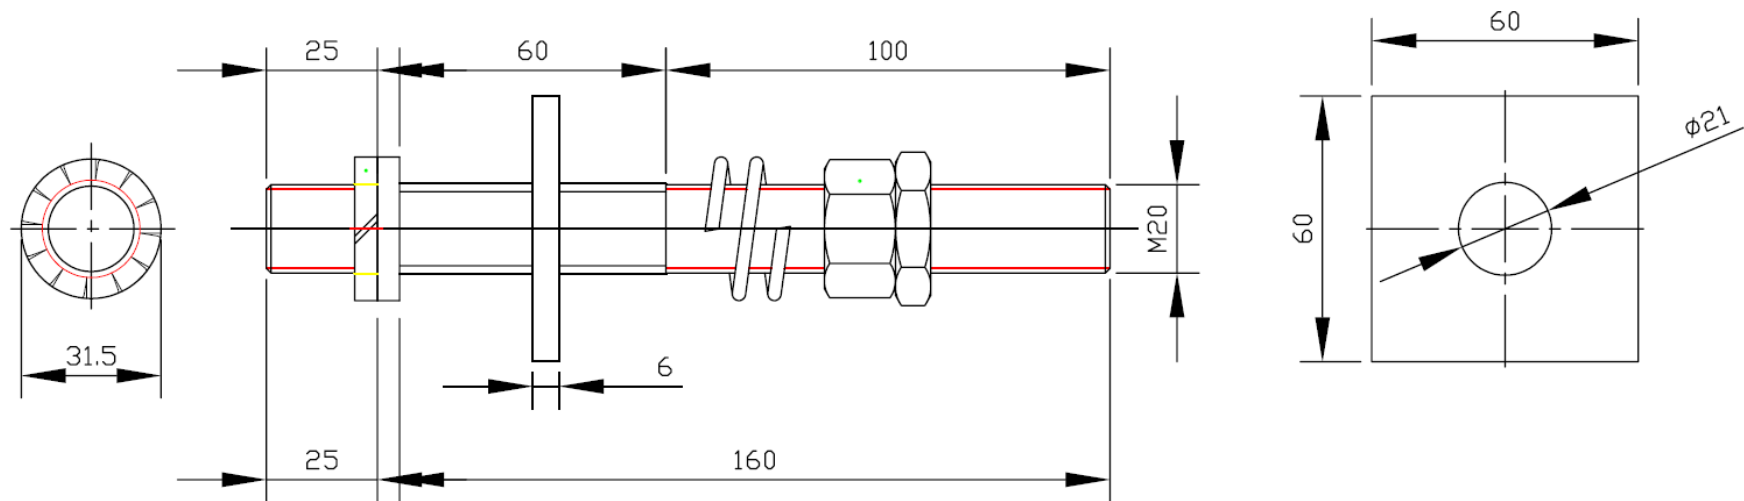

**NOTE:**

1. THE STUDS ARE MADE FROM FORSED STEEL AND GALVANIZED
2. THE SIZE IS M20 SOLID.
3. THE THICKNESS OF HOT DIP GALVANIZING SHALL BE 45  $\mu\text{m}$ (MIN. AVE)

DRAWN	DESIGN	CHECK	APPROVE	DATE	
	C.H.PARK		S.Y.JUNG		
	MAR.08.2012		MAR.08.2012	SCALE	/
PART	INSULATOR STUDS FOR LINE POST INSULATORS				
NAME	160mm-M20 STUD BOLT SET	DWG. NO.	STD160M20		

**DTR CORPORATION**