
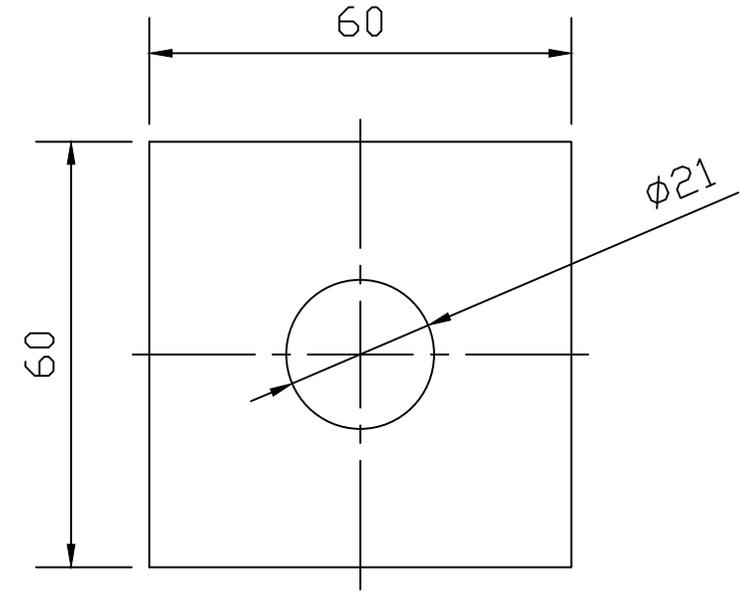


CODE No.

NO.	DESCRIPTION	DWG. NO.	MATERIAL	Q'TY	FINISH/SIZE	NOTE

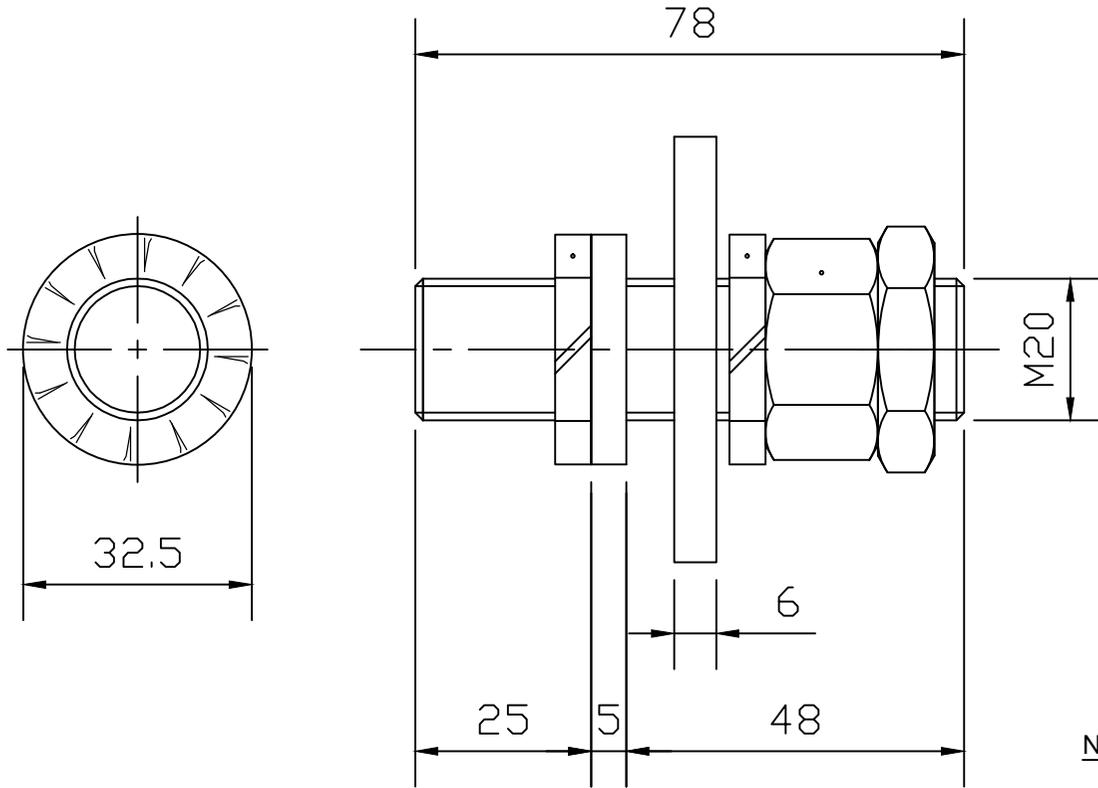

NOTE:

1. THE STUDS ARE MADE FROM FORSED STEEL AND GALVANIZED
2. THE SIZE IS M20 SOLID.
3. THE THICKNESS OF HOT DIP GALVANIZING SHALL BE 50 μm (MIN. AVE)
4. NORMAL TOLERANCE ON ALL DIMENSIONS ARE ACCORDING TO $\pm 5\%$ UNLESS OTHERWISE NOTED.
5. ALL DIMENSIONS ARE MEASURE AFTER HOT GALVANIZED.

O.S	D.S	Q.A	MF	Purchase	Out Supplier

1	STUD BOLT		-	1	
No	NAME		Material	Q'ty	Standard

1/R	10/31/2014	INITIAL RELEASE	J.H.PARK	C.H.PARK	
NO.	DATE	REVISIONS	DESIGNED	APPROVED	REMARKS

DRAWN BY	DESIGNED BY	CHECKED BY	APPROVED BY	SCALE	DATE
J.H.PARK		D.H.YOO	C.H.PARK	1/1	
OCT.31.2014		OCT.31.2014	OCT.31.2014		

NAME	Line Post Insulator For Distribution	
	M20 Stud bolt set(STD48M20)	


DTR CORPORATION

REF.NO.	SHEET NO
DWG.NO.	